

SGT5-4000F Power Plant 298 MW - 50Hz Power Plant for sale – NEW

Location Germany - everything still packed in crates

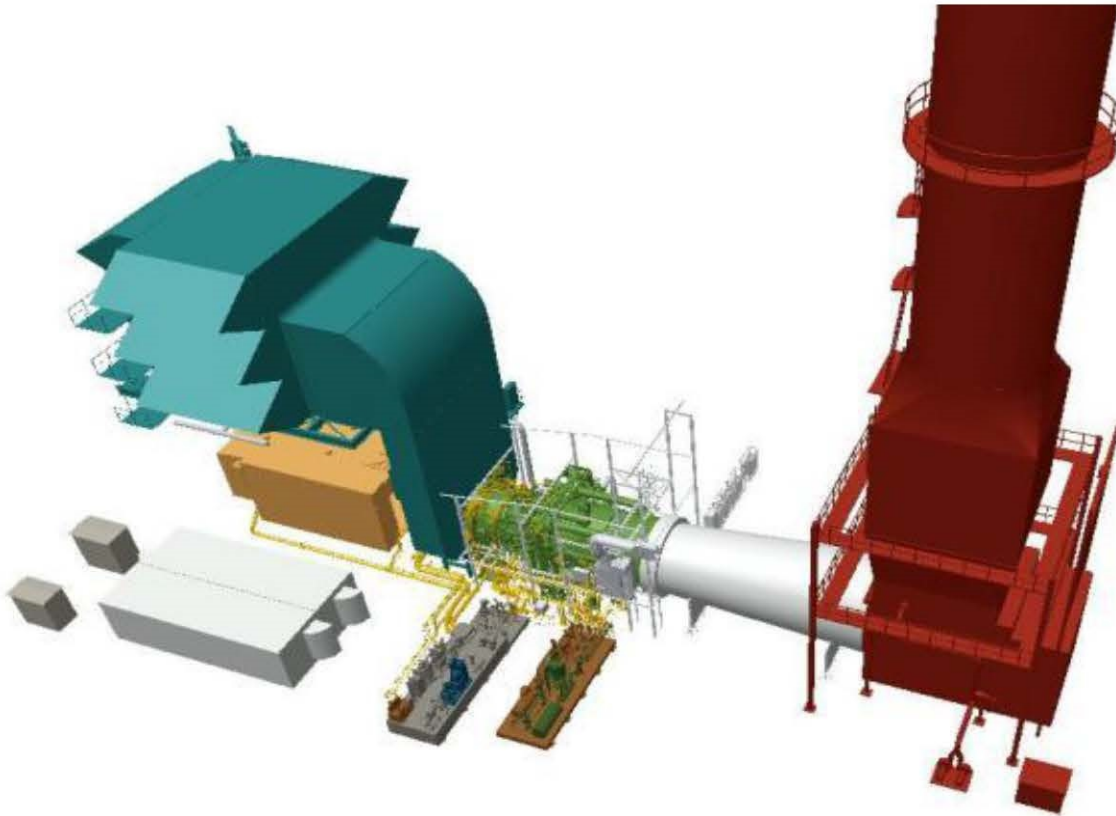


Figure: Arrangement of Gas Turbine Package SGT5-PAC 4000F

The figure shows a typical arrangement of the gas turbine package SGT5-4000F for operation with natural gas as main fuel and distillate fuel oil as secondary fuel. The view is for explanation only and not binding regarding offered scope of supply and for execution. Regarding considered scope of supply, kindly refer to section "Scope of Supply and Services, Terminal Points" within this offer, which shall prevail in case of difference. The power plant is new! It has not been used yet and is still in its packaging.

Location: Germany everything still packed in crates

Scope of Supply

General

The offered scope of supply comprises the delivery of two (2) SGT5-PAC 4000F, including two (2) SGT5-4000F gas turbines, SGen5-1200A generator and associated auxiliary equipment based on the technical description and comments issued in Siemens technical offer.

The scope of supply is completely described in this section. Any hints on equipment, numbers of components etc. given in other sections are not binding even if the wording suggests something different.

Gas Turbine Package

Gas Turbine	Quantity
Gas turbine type SGT5-4000F Number of offered gas turbines	1
Core gas turbine mainly comprising:	
▪ Ring combustor	1
▪ Turbine 1	
▪ Compressor	1
▪ Bearings	1
Loose supplied gas turbine parts, mainly comprising:	
▪ Burners	1 set
▪ Intermediate shaft	1
▪ Gas turbine instrumentation and actuation	1 set
▪ Gas turbine insulation	1 set
▪ Shaft turning gear 1 per gas turbine	
Gas Turbine Auxiliaries	Quantity
Base Module, comprising the auxiliary packages for	1
▪ Fuel gas and ignition gas within separate compartment	
▪ Lube oil with plate type heat exchanger 2x100%	
▪ Hydraulic oil supply for valves and actuators	
▪ Hydraulic clearance optimization	
Natural Gas Flow Metering for Performance Test (loose supply only)	1
Natural Gas Draining System	1
Dual Fuel Module, comprising the auxiliary packages for	1
▪ Fuel oil (with 2x100% fuel oil pumps)	
▪ Purge water	
▪ NOx (with 2x100% NOx water pumps)	
Sealing Air Supply System	1
Advanced Compressor Cleaning System, including piping connection to cleaning water nozzle system	1

Gas Turbine Systems	Quantity
Air Intake System	1
- Filter system with pulse filter stage - Inlet air filter house including weather hood, bird screen, weather louvre, internal support structure, instrumentation, lighting, power sockets, access ladders, platforms and doors - Interconnecting duct work with expansion joint, manhole, damper and silencer - Anti-Icing System - Electrical hoist for maintenance (250kg) - Dehumidifier for gas turbine standstill - Nozzle system for compressor cleaning inside air inlet plenum	
Exhaust Gas System	1
- Exhaust gas diffuser - Compensator between gas turbine and exhaust gas diffuser	
Gas Turbine Control System	
Control System Type	SPPA-T3000
Turbine Controller	1
Redundant automation processor for closed-loop control functions	1/0 modules, as per 1/0
Turbine Failsafe Protection and Trip System	1
- Failsafe system for protection and trip functions - Turbine Function Group Automatic and Operational Protection System - Redundant automation processor for open-loop control functions, sequence control functions and operational protection function	1/0 modules, as per 1/0
L&C Cables	1 set
- Turbine related special instrument cables at turbine and on skids (from sensor to junction box) - Turbine related special control cables (flame monitoring cable)	
Application Server	1
Redundant server for operating, monitoring, engineering function	
Turbine Operating / Monitoring / Engineering System	1
- Operator terminal with 2x 24" LCD monitor, keyboard and mouse - Printer, DIN A4 colour laser	
Turbine Network Bus System	1 set
- SPPA-T3000 bus system with necessary network components - Fiber optic bus cable to plant central control room, maximum length	300m
Signal Interface with Plant Distributed Control System	1 set
Terminal points for hardwired signal exchange	

Maximum number of signals per turbine package	30
Terminal point for bus signal exchange (with OPC)	
Maximum number of signals per turbine package	500
WIN_ TS Diagnostic System	1 set
- WIN_ TS analysis system hardware + peripherals - Software module for gas turbine special condition monitoring - Vibration analysis	

Gas Turbine Electrical Equipment Quantity

Power Control Center (UBA01 / UBA02)	2
AC Power Supply System	
- Low voltage switchgear, AC MCC (BFE / BME) DC	2
Power Supply System	
OC voltage distribution (BUB / BUC)	2
Battery (BTA)	1
Battery charger (BTL)	2
DC/DC converter (BUK)	2

Gas Detection and Fire Protection System Quantity

Gas Detection System	1
- Gas detectors, horns and beacons, control unit - Covering following areas: Gas turbine Enclosure Fuel gas skid	
Fire Detection System for Gas Turbine Unit	1
- Fire detection and control system with local panel - Covering following areas: Gas turbine enclosure and fuel gas skid annex Base Module Power Control Center Dual Fuel Module Generator Bearings	
Fire Extinguishing System	1
- Battery of high pressure bottles far CO₂ and direction valve station - Piping system from bottle rack / storage system to spray nozzles inside the enclosure incl. supports - Covering following areas: Gas Turbine Enclosure Fuel Gas Skid Enclosure PCCs	

Noise Protection Measures**Quantity**

Noise Enclosure for Gas Turbine

1

- Structural steel, with corrosion protection
- Noise abatement panels, galvanized
- Internal service platforms and ladders, galvanized
- Doors with safety windows
- Internal lighting, including emergency lighting

Ventilation System for Gas Turbine Enclosure

- Air intake openings with protective grills, dampers and silencer
- Air handling unit, equipped with back draft dampers, fans including mechanical redundancy, and silencers

Generator**Quantity**

Generator type

SGen5-1200A

SGen6-1200A

Number of offered generators

2

Core generator, each mainly comprising:

- **Stator**, consisting of
 - Base frame 1
 - Stator core, made up of dynamo sheet segments, stacked and pressed together with insulated non-magnetic through bolts
 - Stator winding, three-phase, double layer type, made up from transposed solid strands with MICALASTIC® post-impregnation
- **Rotor**, consisting of
 - Shaft from one piece forging; rotor winding made up of silver alloyed low oxygen copper conductors with radial cooling 1
 - Rotor retaining rings; one piece construction, made up of nonmagnetic steel, which is not susceptible to stress corrosion cracking and is shrunk onto the rotor body 2
 - Single-flow axial fans arranged on the rotor shaft for circulation of the cooling medium 2
 - Steel slip rings arranged on generator shaft 2
- **Bearings**, consisting of
 - Sliding contact bearings with jacking oil device; insulated towards ground, designed for external bearing lube and jacking oil supply (turbine scope) 2
- **Thermocouples** (Type K)
 - Triplex TC embedded in metal of each generator bearing 1
- **Resistance Temperature Detectors** (Platinum, 100 ohms at 0 °C)
 - Slot RTDs embedded in armature windings acc. IEC 60034-3 6
 - Duplex RTDs in the generator warm air cooler inlet 1
 - Duplex RTDs in the generator cold air cooler outlet 2+2

Further equipment:

▪ Cooler cover, consisting of	
Sound proof cover, attached to generator cover	1
Cooler elements, air-to-water (25% each)	4
Liquid level detectors	1
▪ Stator sound proof enclosure	1
▪ Bushings suitable for mounting current transformers	6
▪ All instruments wired to plugs or junction boxes	
▪ Rotor grounding brushes	1 set
▪ Provision for vibration monitoring at bearings	1 set
▪ Space heater	1 set
▪ Special tools for rotor removal, installation, erection and maintenance, one per site per style	
▪ Anchor bolts and nuts	1 set
▪ Levelling plates and primary bearing plates	1 set

Generator Electrical Equipment**Quantity.**

Generator Equipment for Gas Turbine Generator	1
Generator neutral tie enclosure	1
Generator current transformers, line side	3 x 3 cores
Generator current transformers, neutral side	3 x 3 cores
Generator neutral earthing cubicle (BAB11)	1
Protection Equipment far Gas Turbine Generator	1
Generator protection (CHA)	1 set
Generator synchronization (CHA)	1 set
Starting Frequency Converter (SFC) far Gas Turbine Generator (CJT) Line side and machine side B6C converter bridge	1
DC link between line side and machine side converter Overvoltage protection on line side and machine side	
Speed control	
Compressor washing function	
Boiler purge function (for 10 minutes)	
Static Excitation Equipment (SEE) far Gas Turbine Generator (CJN)	1
Fully controlled converter bridge type B6C	
Equipment for rapid de-excitation	
DC side overvoltage protection	
2 channels, each with automatic and manual mode	
Power system stabilizer	
Transformer far Gas Turbine Generator	
SFC transformer with metal enclosure (MBJ)	1
SEE transformer with metal enclosure (MKC)	1





SIEMENS
energy

00000001
000000000000000000000000
000000000000000000000000
000000000000000000000000
000000000000000000000000
000000000000000000000000


Manufactured in Berlin


MD 000 121

27.10.2025 10:21






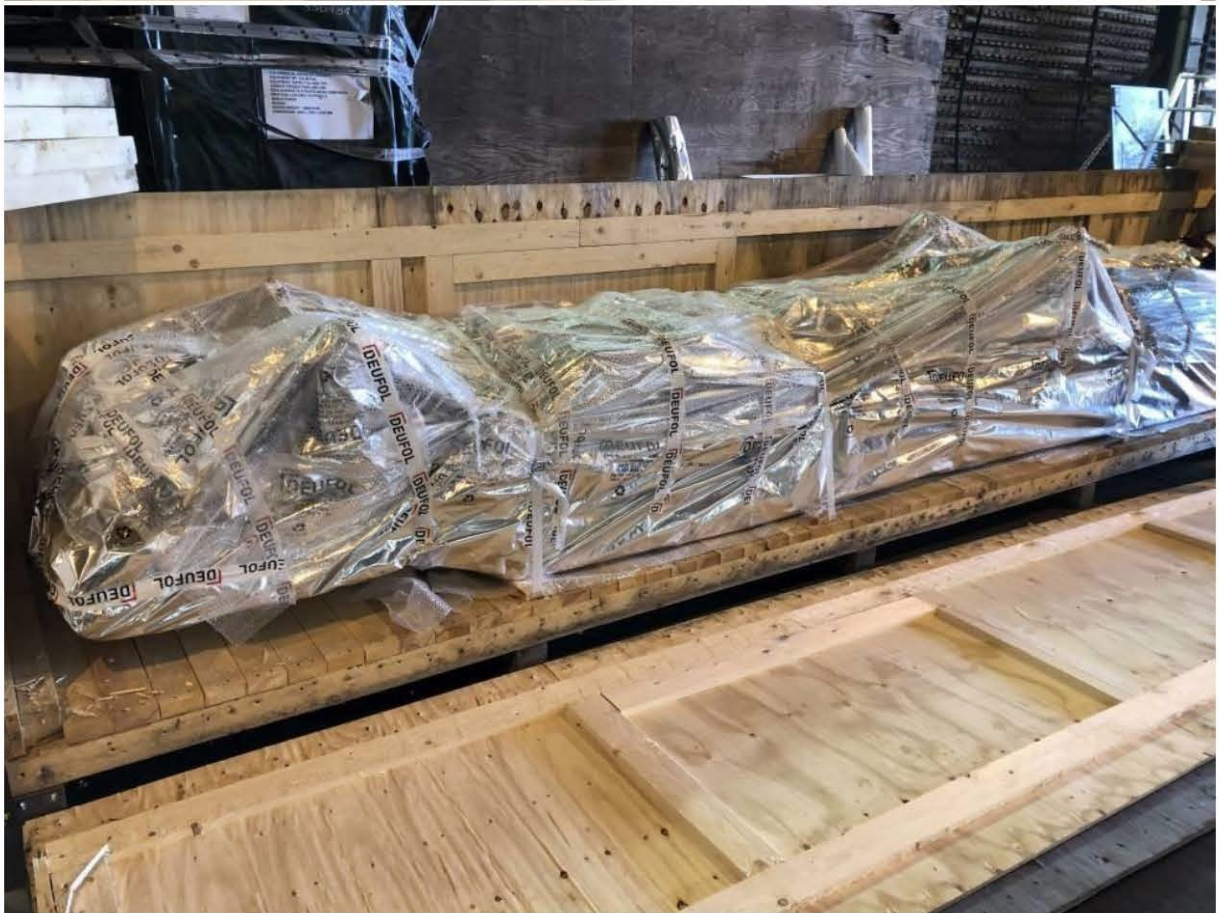

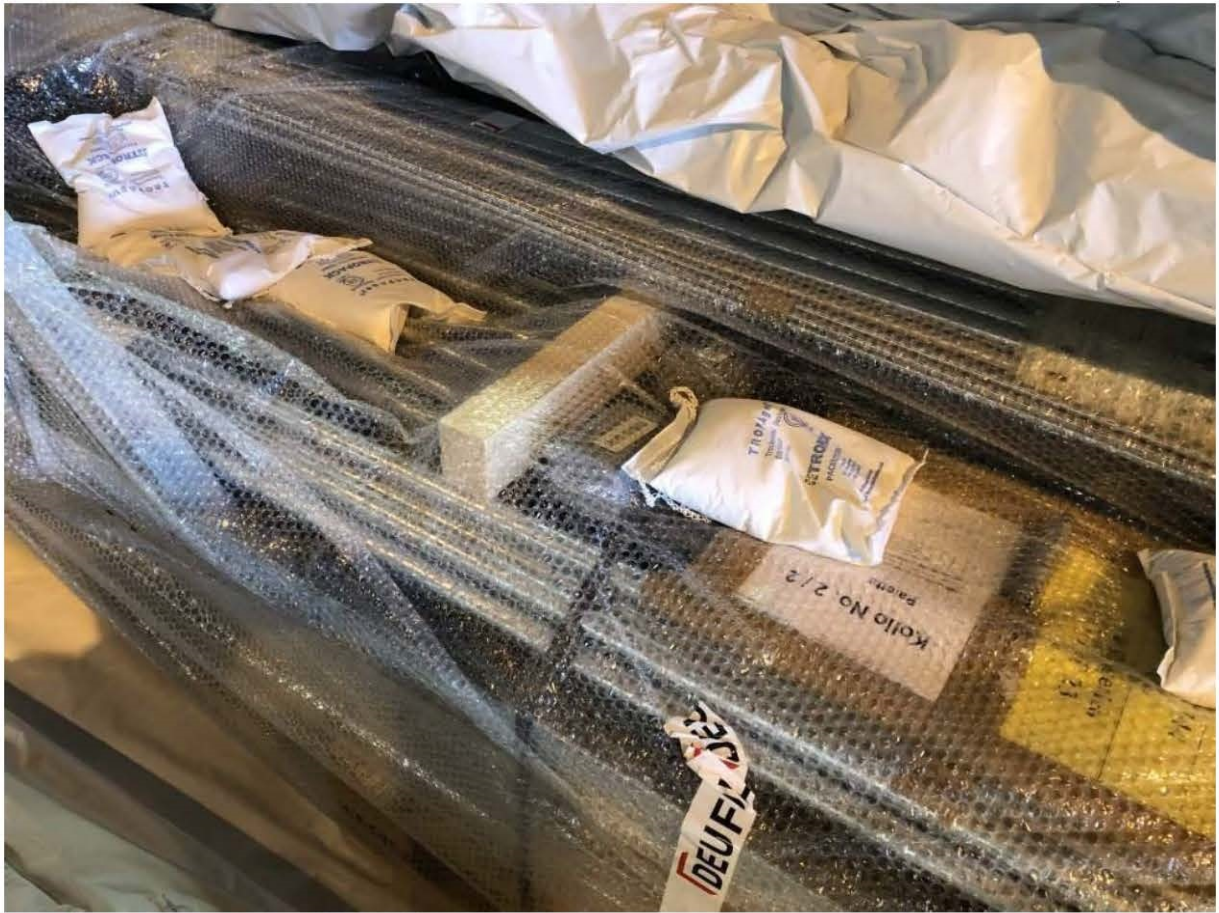



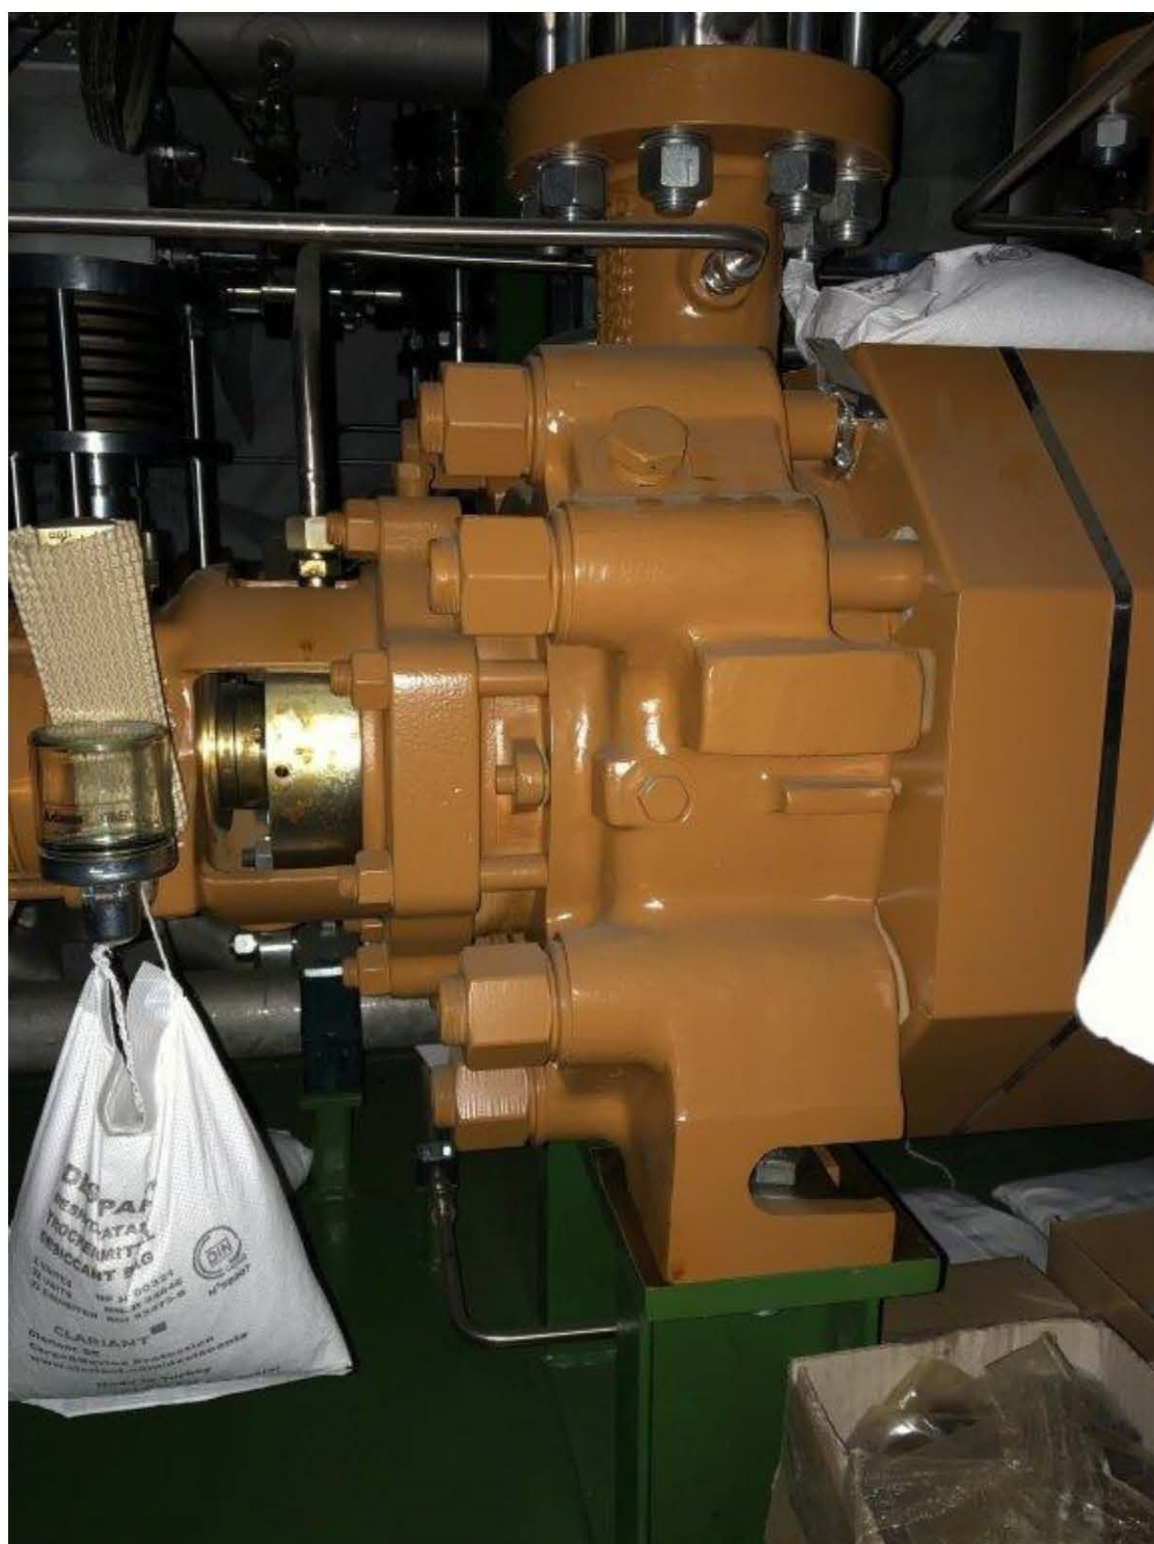



RIK Regeltechnik GmbH
Kornwestheim
www.rik.de
SN: 151026131020 DN: 250 TS: 500°C Kvs: 433
Type: MV 5911 Hub: 60 PS: EN 1092 CE0036

Fais
10-1026



